


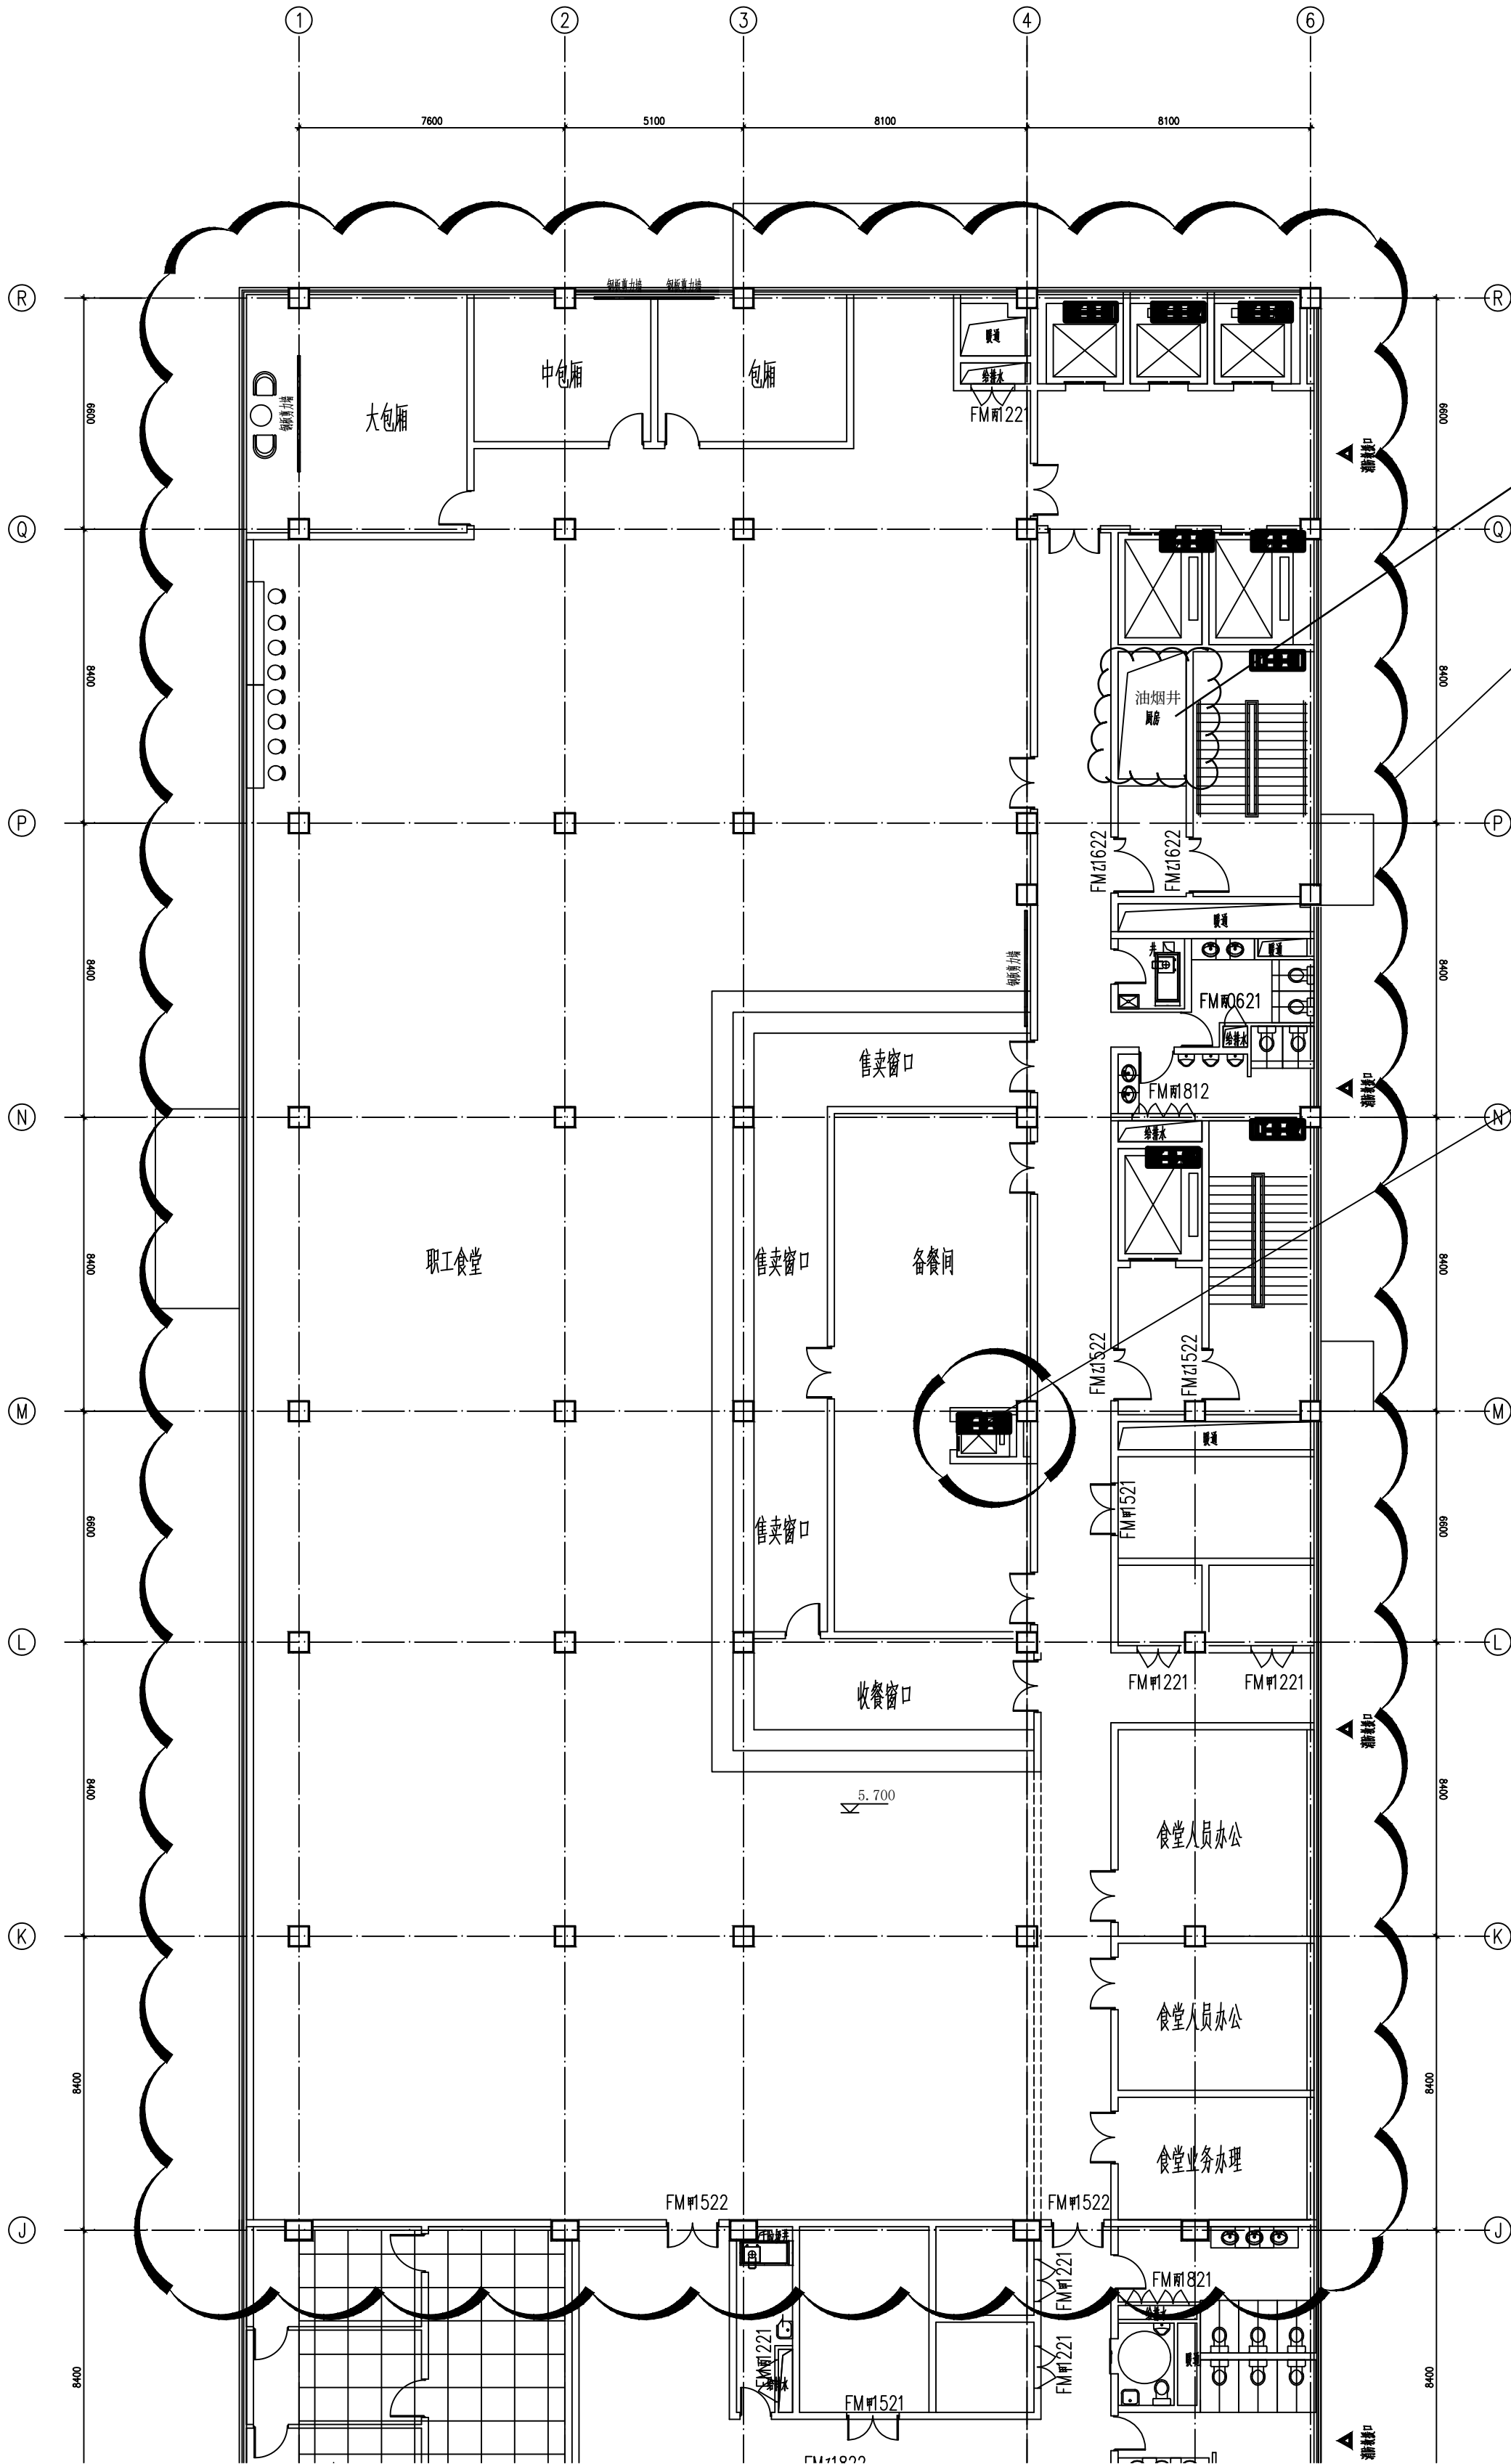

职工餐厅区域

总排风量：43000m³/h

厨房餐梯, 运送餐食到2F 职工餐厅

设备表			
设备名称	规格型号	数量	备注
FM10621	600x2100	1	
FM10621	900x2100	1	
FM10621	1200x2100	4	
FM10621	1800x2100	2	
FM10621	2400x2100	2	
FM10622	1500x2200	4	
FM10622	1800x2200	4	
FM10621	1200x2100	4	
FM10621	1500x2100	3	
FM10622	1500x2200	2	